


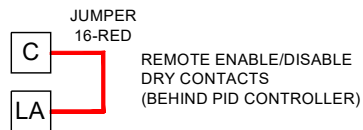



# CONTROL VALVE DIP SWITCH SETTINGS



TERMINAL BLOCK VIEW

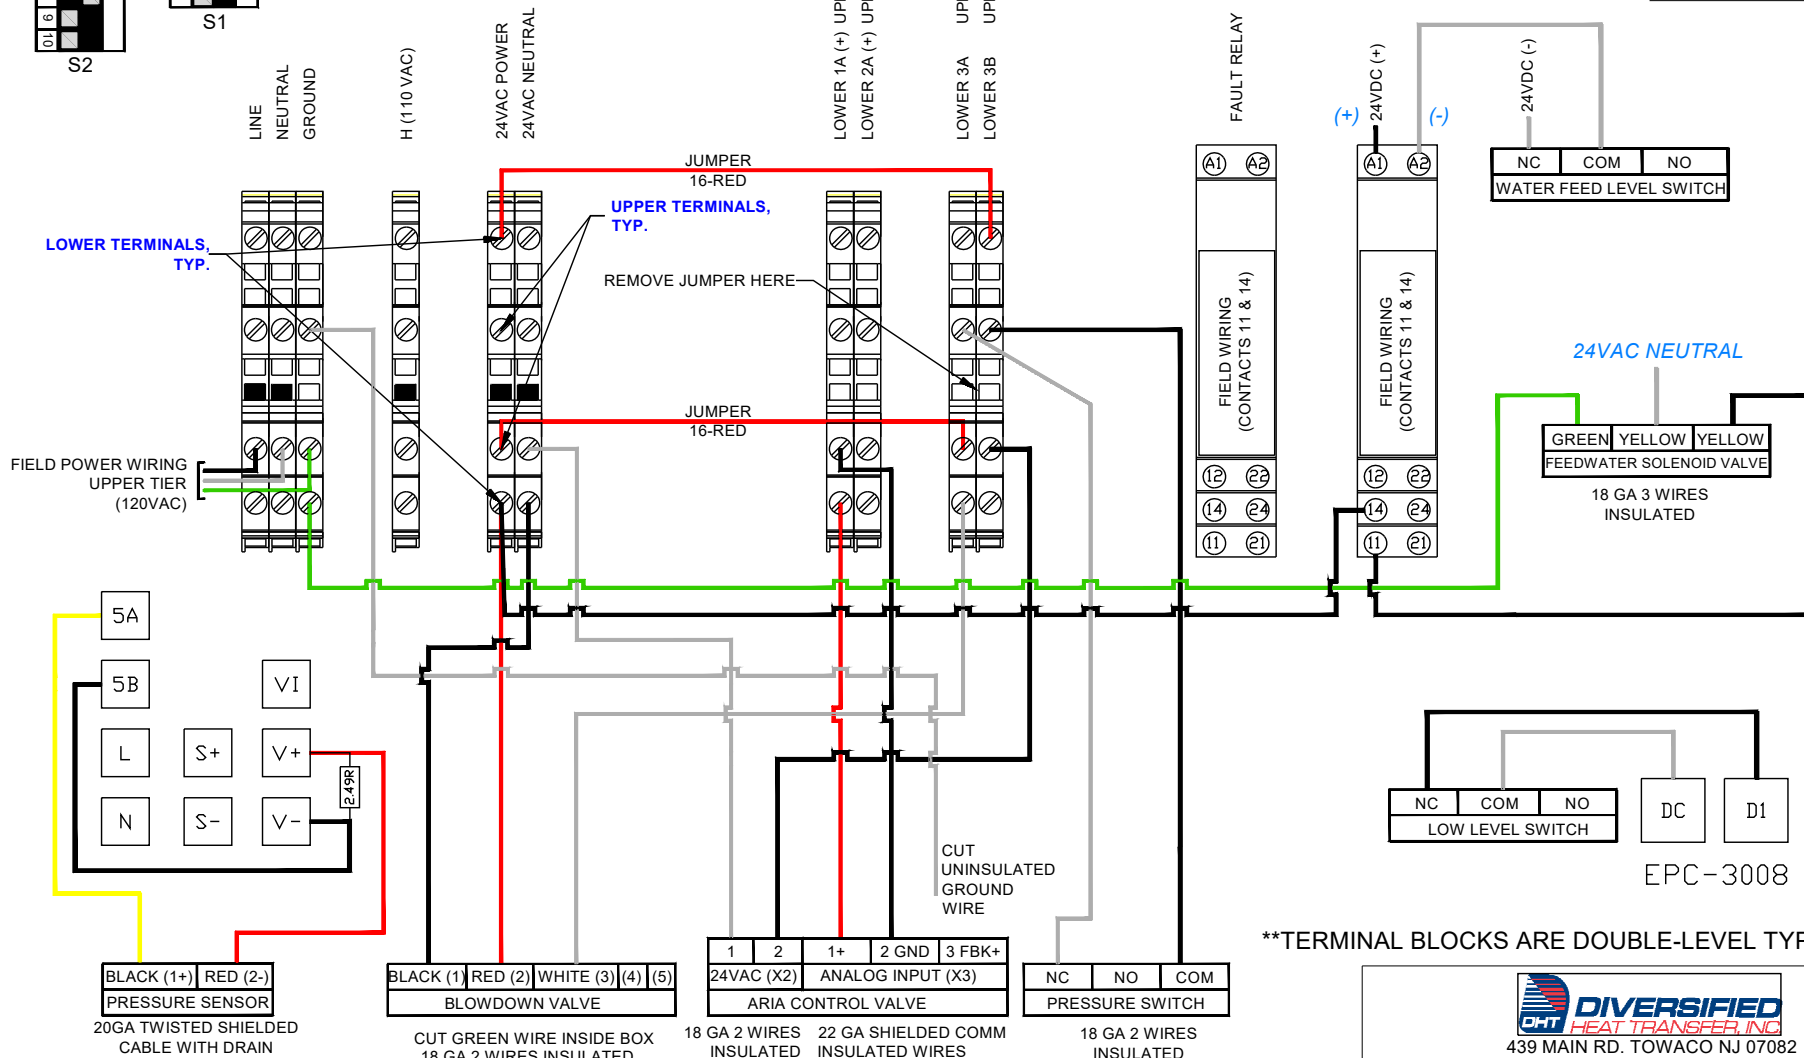

## NOTES:

1. UNIT SHUTS DOWN UPON LOSS OF ELECTRICAL POWER SUPPLY.
2. DO NOT ROUTE COMMUNICATION WIRING AND MAIN POWER WIRING INSIDE SAME CONDUIT.
3. INSTALL EXTERNAL DEDICATED SINGLE POLE, 10 AMP SHUTOFF SWITCH & CIRCUIT BREAKER IN SERIES WITH THE ELECTRICAL POWER TO THE CONTROL PANEL OF THE UNIT.
4. CONSULT LOCAL AND NATIONAL ELECTRICAL CODES AND STANDARDS.
5. DIP SWITCH SETTINGS ON CONTROL VALVE SHOULD MATCH AS SHOWN ON THIS DRAWING.
6. FAULT RELAY HAS ONE SET OF NORMALLY OPEN CONTACTS AND ONE SET OF NORMALLY CLOSED CONTACTS AVAILABLE FOR FIELD CONNECTIONS.

**\*\*TERMINAL BLOCKS ARE DOUBLE-LEVEL TYPE\*\***



439 MAIN RD. TOWACO NJ 07082

PHONE: (800) 221-1522

FAX: (855) 221-2400

SS SERIES  
HIGH PRESSURE CONTROL VALVES  
ELECTRICAL WIRING SCHEMATIC DRAWING

	NAME	DATE	DWG.#	REV
DRAWN BY	SS	08/25/2022	S-55	C
CHECKED BY				