



DIP SWITCH SETTINGS			
1	2	3	4
UP	UP	UP	DOWN

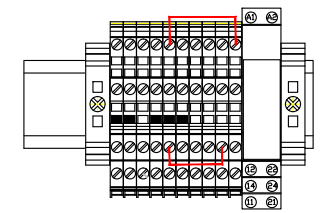


TERMINAL BLOCK VIEW

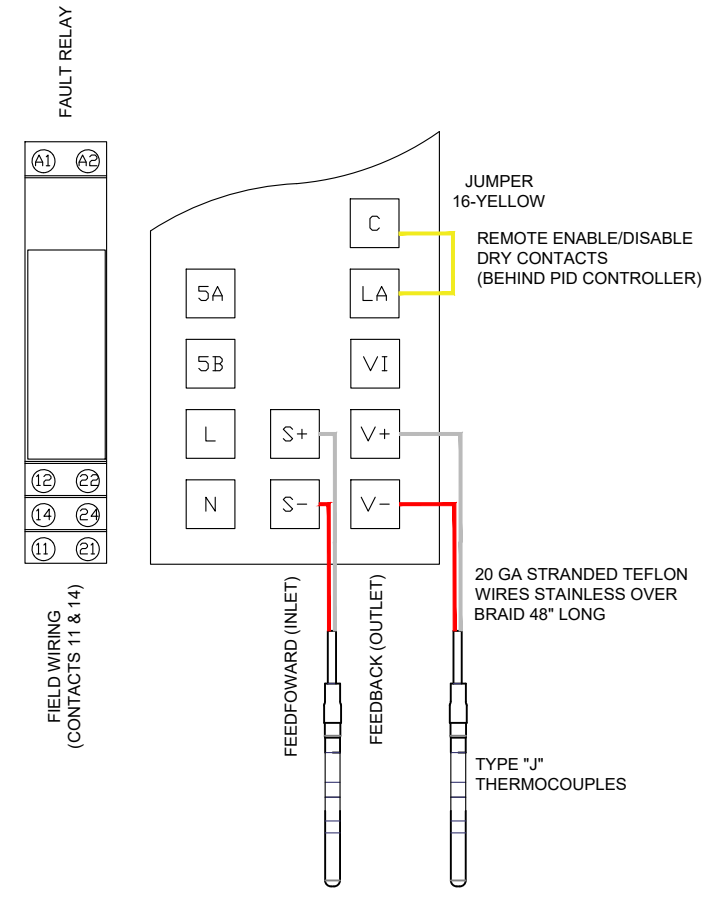

****TERMINAL BLOCKS ARE DOUBLE-LEVEL TYPE****

- NOTES:**
1. UNIT SHUTS DOWN UPON LOSS OF ELECTRICAL POWER SUPPLY.
 2. DO NOT ROUTE COMMUNICATION WIRING AND MAIN POWER WIRING INSIDE SAME CONDUIT.
 3. INSTALL EXTERNAL DEDICATED SINGLE POLE, 10 AMP SHUTOFF SWITCH & CIRCUIT BREAKER IN SERIES WITH THE ELECTRICAL POWER TO THE CONTROL PANEL OF THE UNIT.
 4. CONSULT LOCAL AND NATIONAL ELECTRICAL CODES AND STANDARDS.
 5. ADJUST DIP SWITCH SETTINGS ON CONTROL VALVE AS SHOWN ON THIS DRAWING.
 6. FAULT RELAY HAS ONE SET OF NORMALLY OPEN CONTACTS AND ONE SET OF NORMALLY CLOSED CONTACTS AVAILABLE FOR FIELD CONNECTIONS.
 7. FIELD POWER WIRING TERMINAL BLOCKS LOCATED IN THE TOP RIGHT OF CONTROL BOX



DIVERSIFIED
HEAT TRANSFER INC.
439 MAIN RD. TOWACO NJ 07082
PHONE: (800) 221-1522 FAX: (855) 221-2400

SPC SERIES
ELECTROMAGNETIC 3 WAY CONTROL VALVE (22021-TAB)
ELECTRICAL WIRING DRAWING WITH 2024 CONTROL BOX

	NAME	DATE	DWG.#	REV
DRAWN BY	SC	11/14/2024	S-59	A
CHECKED BY				